DATASHEET - NZMH2-4-VE100-SVE



Circuit-breaker, 4p, 100A, plug-in module

Part no. NZMH2-4-VE100-SVE Catalog No. 113388

-

EL-Nummer (Norway) 4357065



| Delivery program | | | |
|---|-------------------------|----|--|
| Product range | | | Circuit-breaker |
| rotective function | | | Systems, cable, selectivity and generator protection |
| tandard/Approval | | | IEC |
| nstallation type | | | Plug-in units |
| delease system | | | Electronic release |
| construction size | | | NZM2 |
| Description | | | R.m.s. value measurement and "thermal memory" Adjustable time delay setting to overcome current peaks tr at 6 x Ir also infinity (without overload releases) Adjustable delay time tsd $\rm i^2t$ constant function: fixed OFF Set value in neutral conductor is synchronous with set value Ir of main pole. |
| lumber of poles | | | 4 pole |
| Standard equipment | | | Screw connection |
| Switching capacity | | | |
| 400/415 V 50 Hz | I _{cu} | kA | 150 |
| lated current = rated uninterrupted current | | | |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 100 |
| Neutral conductor | % of phase conductor | % | 100 |
| Setting range | | | |
| Overload trip | | | |
| 中 | I _r | Α | 50 - 100 |
| Main pole | l _r | A | 50 - 100 |
| Short-circuit releases | | | |
| Non-delayed | $I_i = I_n \ x \ \dots$ | | 1200 A fixed |
| Delayed | $I_{sd} = I_r x \dots$ | | 2 - 10 |

Technical data

Genera

| | IEC/EN 60947 |
|----|--|
| | Finger and back of hand proof to VDE 0106 Part 100 |
| | Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30 |
| | |
| °C | - 40 - + 70 |
| °C | -25 - +70 |
| g | 20 (half-sinusoidal shock 20 ms) |
| | |
| | |

| Between auxiliary contacts and main contacts | | V AC | 500 |
|---|------------------|------|---|
| between the auxiliary contacts | | V AC | 300 |
| Mounting position | | | Vertical and 90° in all directions With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions |
| Direction of incoming supply | | | as required |
| Degree of protection | | | |
| Device | | | In the operating controls area: IP20 (basic degree of protection) |
| Enclosures | | | With insulating surround: IP40 With door coupling rotary handle: IP66 |
| Terminations | | | Tunnel terminal: IP10 Phase isolator and strip terminal: IP00 |
| Other technical data (sheet catalogue) Circuit-breakers | | | Temperature dependency, Derating |
| Rated current = rated uninterrupted current | $I_n = I_u$ | Α | 100 |
| Rated surge voltage invariability | U _{imp} | | |
| Main contacts | P | V | 8000 |
| Auxiliary contacts | | V | 6000 |
| Rated operational voltage | U _e | V AC | 690 |
| Overvoltage category/pollution degree | | | III/3 |
| Rated insulation voltage | Ui | V | 1000 |
| Use in unearthed supply systems | | ٧ | ≦ 690 |
| Switching capacity | | | |
| Rated short-circuit making capacity | I _{cm} | | |
| 240 V | I _{cm} | kA | 330 |
| 400/415 V | I _{cm} | kA | 330 |
| 440 V 50/60 Hz | I _{cm} | kA | 286 |
| 525 V 50/60 Hz | I _{cm} | kA | 105 |
| 690 V 50/60 H | Ic | kA | 40 |
| Rated short-circuit breaking capacity I _{cn} | I _{cn} | | |
| Icu to IEC/EN 60947 test cycle 0-t-C0 | lcu | kA | |
| 240 V 50/60 Hz | I _{cu} | kA | 150 |
| 400/415 V 50/60 Hz | I _{cu} | kA | 150 |
| 440 V 50/60 Hz | I _{cu} | kA | 130 |
| 525 V 50/60 Hz | I _{cu} | kA | 50 |
| 690 V 50/60 Hz | I _{cu} | kA | 20 |
| Ics to IEC/EN 60947 test cycle 0-t-C0-t-C0 | Ics | kA | |
| 240 V 50/60 Hz | I _{cs} | kA | 150 |
| 400/415 V 50/60 Hz | I _{cs} | kA | 150 |
| 440 V 50/60 Hz | I _{cs} | kA | 130 |
| 525 V 50/60 Hz | I _{cs} | kA | 37.5 |
| 690 V 50/60 Hz | I _{cs} | kA | 5 |
| | | | Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker. |
| Rated short-time withstand current | | | |
| t = 0.3 s | I _{cw} | kA | 1.9 |
| t = 1 s | I _{cw} | kA | 1.9 |
| Utilization category to IEC/EN 60947-2 | | | A |
| Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release) | Operations | | 20000 |

| Lifespan, electrical | | | |
|---|------------|-----------------|---|
| AC-1 | | | |
| 400 V 50/60 Hz | Operations | | 10000 |
| 415 V 50/60 Hz | Operations | | 10000 |
| 690 V 50/60 Hz | Operations | | 7500 |
| AC3 | | | |
| 400 V 50/60 Hz | Operations | | 6500 |
| 415 V 50/60 Hz | Operations | | 6500 |
| 690 V 50/60 Hz | Operations | | 5000 |
| Max. operating frequency | | Ops/h | 120 |
| Total break time at short-circuit | | ms | <10 |
| Terminal capacity | | | |
| Standard equipment | | | Screw connection |
| Accessories required | | | NZM2-4-XSVS |
| Optional accessories | | | Box terminal Tunnel terminal connection on rear |
| Round copper conductor | | | |
| Box terminal | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Tunnel terminal Solid | | 2 | 1 x 16 |
| | | mm ² | 1 X 10 |
| Stranded | | | |
| 1-hole | | mm ² | 1 x (25 - 185) |
| Bolt terminal and rear-side connection | | | |
| Direct on the switch | | | |
| Solid | | mm ² | 1 x (10 - 16) 2 x (6 - 16) |
| Stranded | | mm ² | 1 x (25 - 185) 2 x (25 - 70) |
| Al circular conductor | | | |
| Tunnel terminal | | | |
| Solid | | mm ² | 1 x 16 |
| Stranded | | | |
| Stranded | | mm^2 | 1 x (25 - 185) |
| Cu strip (number of segments x width x segment thickness) | | | |
| Box terminal | | | |
| | min. | mm | 2 x 9 x 0.8 |
| | max. | mm | 10 x 16 x 0.8 (2x) 8 x 15.5 x 0,8 |
| Bolt terminal and rear-side connection | | | |
| Flat copper strip, with holes | min. | mm | 2 x 16 x 0.8 |
| Flat copper strip, with holes | max. | mm | 10 x 24 x 0.8 |
| Copper busbar (width x thickness) | mm | | |
| Bolt terminal and rear-side connection | | | |
| Screw connection | | | M8 |
| Direct on the switch | | | |
| | min. | mm | 16 x 5 |
| | max. | mm | 24 x 8 |
| Control cables | | | |
| | | mm ² | 1 x (0.75 - 2.5) 2 x (0.75 - 1.5) |
| D ' 'C' (' IFO/FN 04 400 | | | |

Design verification as per IEC/EN 61439

| Technical data for design verification | | | | |
|--|--|--|--|--|
|--|--|--|--|--|

| Rated operational current for specified heat dissipation | In | Α | 100 |
|--|------------------|----|--|
| Equipment heat dissipation, current-dependent | P _{vid} | W | 8.25 |
| Operating ambient temperature min. | | °C | -25 |
| Operating ambient temperature max. | | °C | 70 |
| IEC/EN 61439 design verification | | | |
| 10.2 Strength of materials and parts | | | |
| 10.2.2 Corrosion resistance | | | Meets the product standard's requirements. |
| 10.2.3.1 Verification of thermal stability of enclosures | | | Meets the product standard's requirements. |
| 10.2.3.2 Verification of resistance of insulating materials to normal heat | | | Meets the product standard's requirements. |
| $10.2.3.3\ Verification\ of\ resistance\ of\ insulating\ materials\ to\ abnormal\ heat\ and\ fire\ due\ to\ internal\ electric\ effects$ | | | Meets the product standard's requirements. |
| 10.2.4 Resistance to ultra-violet (UV) radiation | | | Meets the product standard's requirements. |
| 10.2.5 Lifting | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.6 Mechanical impact | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.2.7 Inscriptions | | | Meets the product standard's requirements. |
| 10.3 Degree of protection of ASSEMBLIES | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.4 Clearances and creepage distances | | | Meets the product standard's requirements. |
| 10.5 Protection against electric shock | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.6 Incorporation of switching devices and components | | | Does not apply, since the entire switchgear needs to be evaluated. |
| 10.7 Internal electrical circuits and connections | | | Is the panel builder's responsibility. |
| 10.8 Connections for external conductors | | | Is the panel builder's responsibility. |
| 10.9 Insulation properties | | | |
| 10.9.2 Power-frequency electric strength | | | Is the panel builder's responsibility. |
| 10.9.3 Impulse withstand voltage | | | Is the panel builder's responsibility. |
| 10.9.4 Testing of enclosures made of insulating material | | | Is the panel builder's responsibility. |
| 10.10 Temperature rise | | | The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices. |
| 10.11 Short-circuit rating | | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$ |
| 10.12 Electromagnetic compatibility | | | Is the panel builder's responsibility. The specifications for the switch gear must be observed. $\label{eq:constraint}$ |
| 10.13 Mechanical function | | | The device meets the requirements, provided the information in the instruction leaflet (IL) is observed. |
| | | | |

Technical data ETIM 7.0


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)


Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])


| Rated permanent current lu Rated voltage V 690 - 690 Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Nated short-circuit breaking capacity Icu at 400 V, 50 Hz A 150 Overload release current setting A 50 - 100 Adjustment range short-term delayed short-circuit release A 100 - 1000 Adjustment range undelayed short-circuit release A 1200 - 1200 Integrated earth fault protection Type of electrical connection of main circuit Device construction Built-in device plug-in technique | |
|--|--|
| Rated short-circuit breaking capacity Icu at 400 V, 50 Hz Overload release current setting A 50 - 100 Adjustment range short-term delayed short-circuit release A 100 - 1000 Adjustment range undelayed short-circuit release A 1200 - 1200 Integrated earth fault protection Type of electrical connection of main circuit Device construction KA 150 No Some connection Built-in device plug-in technique | |
| Overload release current setting A 50 - 100 Adjustment range short-term delayed short-circuit release A 100 - 1000 Adjustment range undelayed short-circuit release A 1200 - 1200 Integrated earth fault protection Type of electrical connection of main circuit Device construction A 1200 - 1200 No Screw connection Built-in device plug-in technique | |
| Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release Adjustment range short-term delayed short-circuit release Adjustment range short-term delayed short-circuit release Adjustment range undelayed short-circuit release Adjustment | |
| Adjustment range undelayed short-circuit release A 1200 - 1200 Integrated earth fault protection Type of electrical connection of main circuit Device construction A 1200 - 1200 No Screw connection Built-in device plug-in technique | |
| Integrated earth fault protection Type of electrical connection of main circuit Device construction No Screw connection Built-in device plug-in technique | |
| Type of electrical connection of main circuit Device construction Screw connection Built-in device plug-in technique | |
| Device construction Built-in device plug-in technique | |
| | |
| | |
| Suitable for DIN rail (top hat rail) mounting | |
| DIN rail (top hat rail) mounting optional | |
| Number of auxiliary contacts as normally closed contact 0 | |
| Number of auxiliary contacts as normally open contact 0 | |
| Number of auxiliary contacts as change-over contact 0 | |
| With switched-off indicator | |
| With under voltage release No | |
| Number of poles 4 | |
| Position of connection for main current circuit Front side | |
| Type of control element Rocker lever | |

| Complete device with protection unit | Yes |
|--------------------------------------|------|
| Motor drive integrated | No |
| Motor drive optional | Yes |
| Degree of protection (IP) | IP20 |

Characteristics

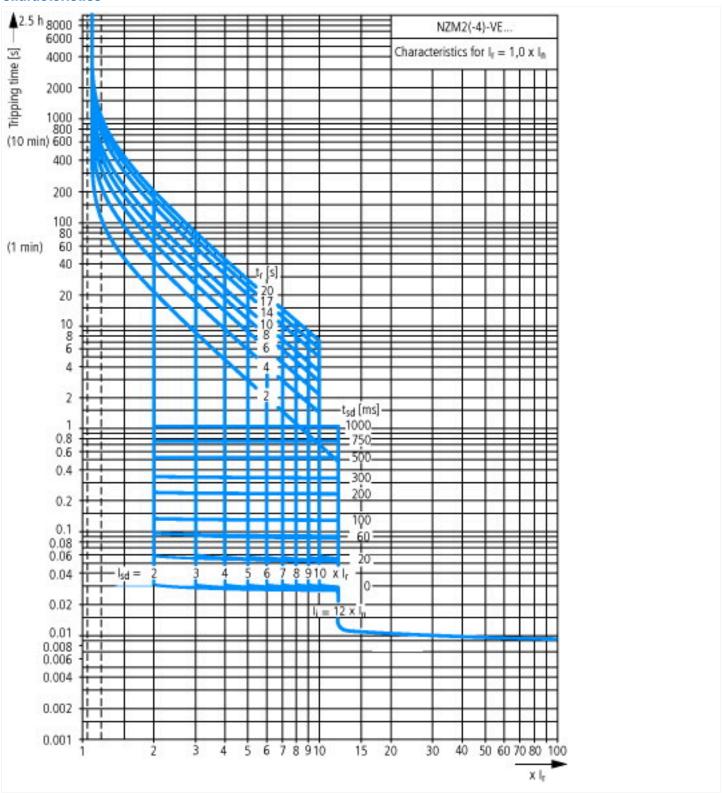


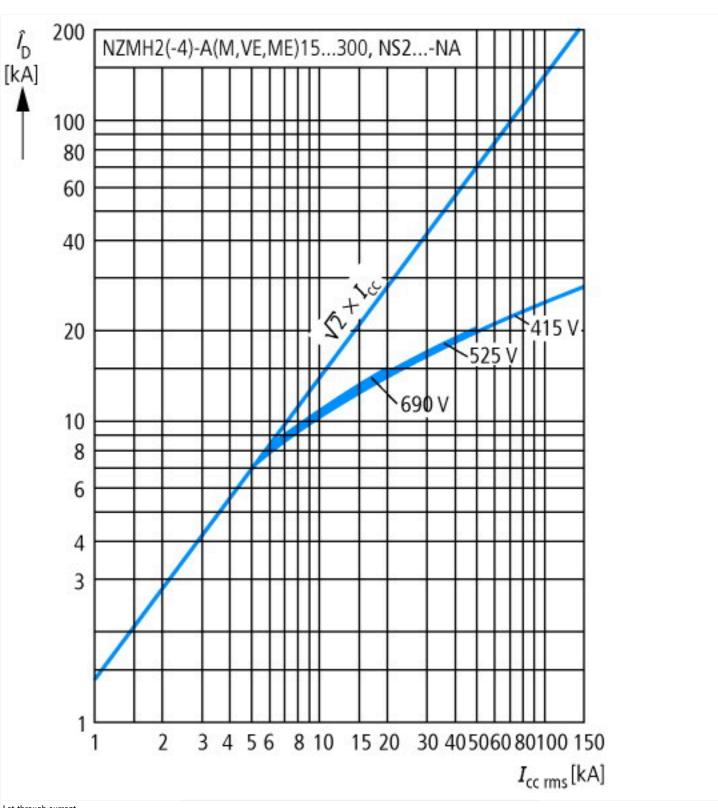


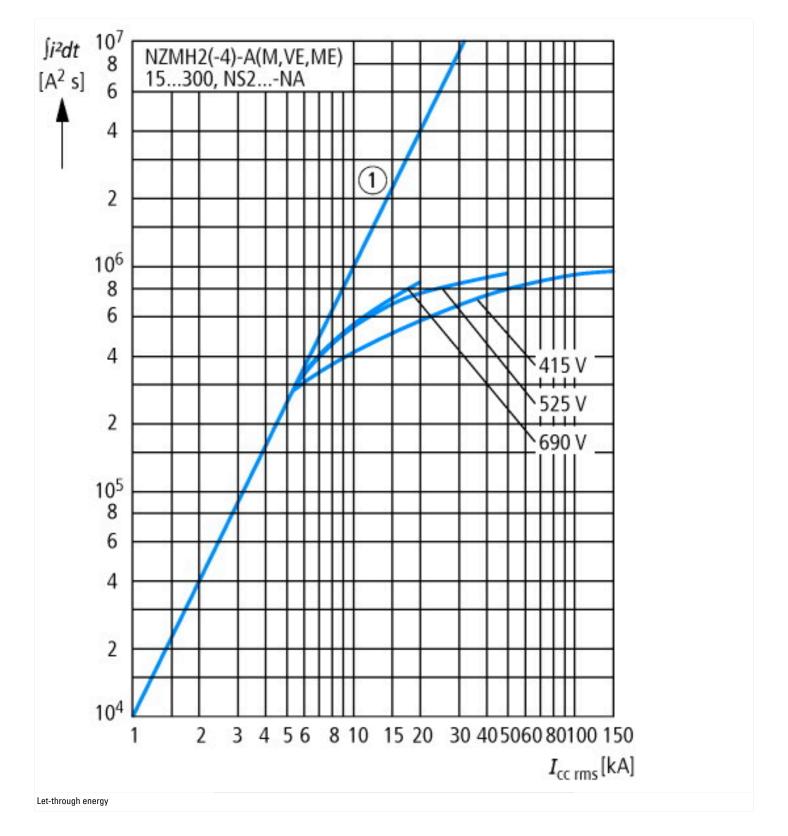


Eaton 113388 ED2022 V88.0 EN

Dimensions

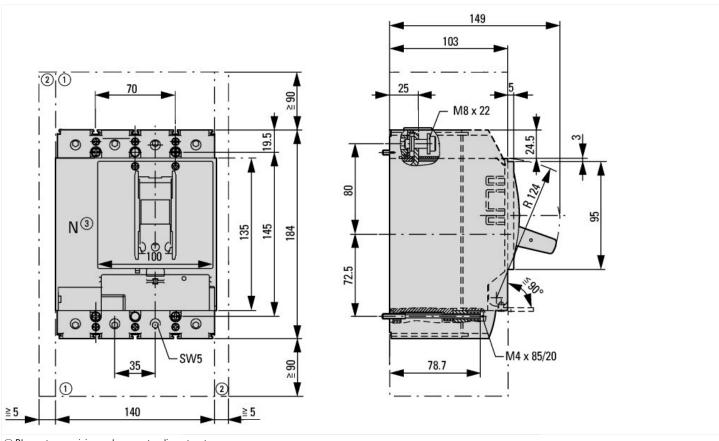

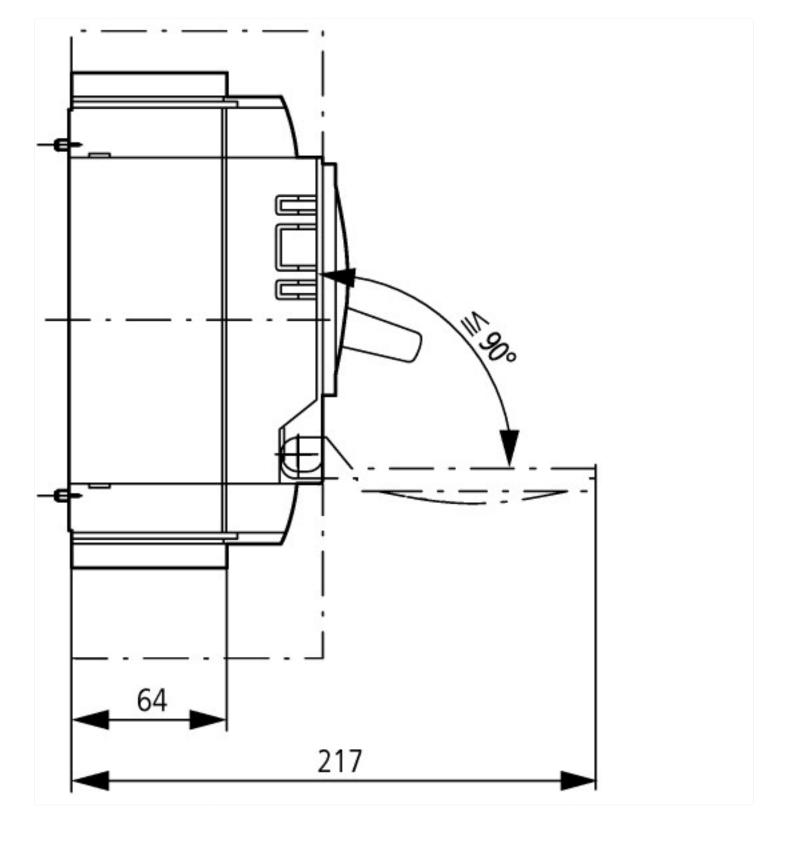

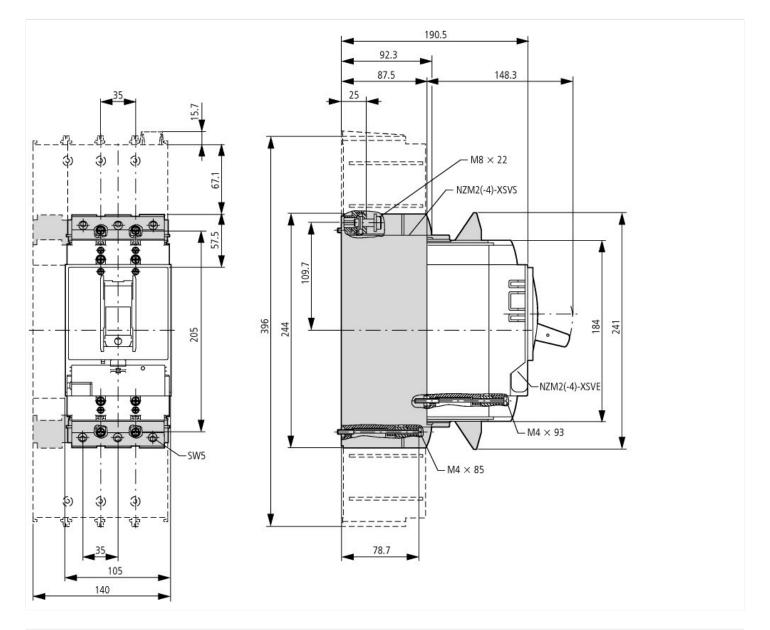

Additional product information (links)

| radiation product in the control (in the contr | |
|--|--|
| Temperature dependency, Derating | http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172 |
| CurveSelect characteristics program | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/CharacteristicsProgram/index.htm |
| Eaton configurator | http://www.eaton.eu/DE/Europe/Electrical/CustomerSupport/ConfigurationTools/ConfiguratorCircuitBreaker/index.htm |
| additional technical information for NZM power switch | https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf |