## **DATASHEET - NZMN4-4-PX1600/VAR-TAZ**



NZM4 PXR25 circuit breaker - integrated energy measurement class 1, 1600A, 4p, variable, Screw terminal, earth-fault protection, ARMS and zone selectivity



NZMN4-4-PX1600/VAR-TAZ Part no. Catalog No. 189655

Protective function  Standard Approval  From the protection and delayed and non-delayed short-circuit protection deviews, desirable function with Power Xpert Protection Wanages software 2 and a public formulation or capable with internal Modbus RTU module or CAM Apple Standard equipment  Solution and early function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a public function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 and a function with Power Xpert Protection Wanages software 2 a	Delivery program			
Standard Approval Standard Approval Standard Approval Installation type Release system Construction size Description Construction size Description  Release system Construction size Description and designed and non-delayed short-circuit presented with release min.  Release system Release syste	Product range			Circuit-breaker
Installation type  Release system  Construction size  Description  Release system  Construction size  Fig. 10 system  F	Protective function			Earth-fault protection Zone selectivity
Release system Construction size Description Construction size Construction size Description Construction size Construction size Construction size Construction size Construction size Construction Construction size Construction Construction capacity Construction conduct on early instruction with Power Xpert Protection Manager software Construction Size Construction Capacity Construc	Standard/Approval			IEC
Description  Les cription  Le	Installation type			Fixed
Description  List Goverload protection and delayed and non-delayed short-circuit protective device, earth-fault protection Class learney measurement, and 'thermal memory' USB interface for configuration and test function with Power Xpert Protection Manager software Zone selectivity ZSI minerface module in equipment supplied.  Number of poles Standard equipment  Switching capacity  400415 V50 Hz  400415 V50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Noutral conductor  Voerload trip  Lip   A	Release system			Electronic release
Setting range   Poles   Pole	Construction size			NZM4
Standard equipment  Switching capacity  400/415 V 50 Hz  A00/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Neutral conductor  Overload trip  Ir  A  640 - 1600  Short-circuit releases  Ir  Non-delayed  Delayed  Delayed  Delayed  Delayed  Setting range of earth fault release min.  Ig = Inx  Ig = I	Description			device, earth-fault protection Class 1 energy measurement, r.m.s. value measurement, and "thermal memory" USB interface for configuration and test function with Power Xpert Protection Manager software Zone selectivity ZSI Maintenance Mode ARMS Interface module in equipment supplied.
Switching capacity  400/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Neutral conductor  Softing range  Overload trip  Ir A 640 - 1600  Short-circuit releases  Non-delayed  Delayed  Delayed  Setting range of earth fault release min.  Ig = Inx  Ig = Inx  Jg = Inx	Number of poles			4 pole
404/415 V 50 Hz  Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Neutral conductor  Neutral conductor  Overload trip  Ir  A  640 - 1600  Short-circuit releases  Non-delayed  Delayed  Del	Standard equipment			Screw connection
Rated current = rated uninterrupted current  Rated current = rated uninterrupted current  Neutral conductor  Setting range  Overload trip  Ir A  640 - 1600  Short-circuit releases  Non-delayed  Delayed  Delayed  Delayed  Delayed  Setting range of earth fault release min.  Ig = Inx  Ig = Inx  Ig = Inx  Jag =	Switching capacity			
Rated current = rated uninterrupted current $I_n = I_u$ A       1600         Neutral conductor       % of phase conductor       0 - 60 - 100         Setting range       Overload trip       Ir       A       640 - 1600         Short-circuit releases       Image: Image	400/415 V 50 Hz	I <sub>cu</sub>	kA	50
Neutral conductor  Setting range  Overload trip  Ir A 640 - 1600  Short-circuit releases  Non-delayed  Delayed  Delayed  Delayed  Delayed  Setting range of earth fault release min.  Ig = In x  Ig = In x  Ig = In x  Jg =	Rated current = rated uninterrupted current			
Setting range  Overload trip  Ir A 640 - 1600  Short-circuit releases  Non-delayed Delayed Delayed Setting range of earth fault release min.  Ig = In x	Rated current = rated uninterrupted current	$\boldsymbol{I}_n = \boldsymbol{I}_u$	Α	1600
Overload trip  Ir A 640 - 1600  Short-circuit releases  Non-delayed Delayed Delayed Setting range of earth fault release min.  Ir A 640 - 1600  2 - 12  2 - 12  320	Neutral conductor		%	0 - 60 - 100
Short-circuit releases  Non-delayed  Delayed $l_i = l_n \times$ $l_i$	Setting range			
Short-circuit releases $I_{i} = I_{n} \times \dots \qquad 2-12$ Non-delayed $I_{sd} = I_{r} \times \dots \qquad 2-10$ Delayed $I_{sd} = I_{r} \times \dots \qquad 2-10$ Setting range of earth fault release min. $I_{g} = I_{n} \times \dots \qquad 320$	Overload trip			
Non-delayed	中	l <sub>r</sub>	Α	640 - 1600
Delayed Isd = Ir x 2 - 10  Setting range of earth fault release min. Ig = Inx 320	Short-circuit releases			
Setting range of earth fault release min.  Ig = Inx 320		$I_i = I_n \times \dots$		2 – 12
	Secretaria de la companya del companya de la companya del companya de la companya	$I_{sd} = I_r \times \dots$		2 – 10
Setting range of earth fault release max. Ig = Inx 1600	Setting range of earth fault release min.	Ig = Inx		320
	Setting range of earth fault release max.	Ig = Inx		1600

# **Technical data**

General		
Standards		IEC/EN 60947
Protection against direct contact		Finger and back of hand proof to VDE 0106 Part 100
Climatic proofing		Damp heat, constant, to IEC 60068-2-78 Damp heat, cyclic, to IEC 60068-2-30
Ambient temperature		
Ambient temperature, storage	°C	- 40 - + 70

Operation		°C	-25 - +70
Mechanical shock resistance (10 ms half-sinusoidal shock) according to IEC 60068-2-27		g	15 (half-sinusoidal shock 11 ms)
Safe isolation to EN 61140			
Between auxiliary contacts and main contacts		V AC	500
between the auxiliary contacts		V AC	300
Mounting position			With XFI earth-fault release: - NZM1, N1, NZM2, N2: vertical and 90° in all directions with plug-in unit - NZM1, N1, NZM2, N2: vertical, 90° right/left with withdrawable unit: - NZM3, N3: vertical, 90° right/left - NZM4, N4: vertical with remote operator: - NZM2, N(S)2, NZM3, N(S)3, NZM4, N(S)4: vertical and 90° in all directions
Direction of incoming supply			as required
Degree of protection			
Device			In the operating controls area: IP20 (basic degree of protection)
Enclosures			With insulating surround: IP40 With door coupling rotary handle: IP66
Terminations			Tunnel terminal: IP10 Phase isolator and strip terminal: IP00
Other technical data (sheet catalogue)			Weight Temperature dependency, Derating Effective power loss
Circuit-breakers	1 -1	٨	1600
Rated current = rated uninterrupted current	$I_n = I_u$	Α	1600
Rated surge voltage invariability	U <sub>imp</sub>	V	9000
Main contacts		V	8000
Auxiliary contacts		V AC	6000 690
Rated operational voltage	U <sub>e</sub>	V AC	111/3
Overvoltage category/pollution degree Rated insulation voltage	Ui	V	1000
Use in unearthed supply systems	O <sub>1</sub>	V	≦ 525
Switching capacity		•	= 323
Rated short-circuit making capacity	I <sub>cm</sub>		
240 V	I <sub>cm</sub>	kA	105
400/415 V	I <sub>cm</sub>	kA	105
440 V 50/60 Hz	I <sub>cm</sub>	kA	74
525 V 50/60 Hz	I <sub>cm</sub>	kA	53
690 V 50/60 H	Ic	kA	40
Rated short-circuit breaking capacity I <sub>cn</sub>	I <sub>cn</sub>		
Icu to IEC/EN 60947 test cycle 0-t-C0	lcu	kA	
240 V 50/60 Hz	Icu	kA	50
400/415 V 50/60 Hz	I <sub>cu</sub>	kA	50
440 V 50/60 Hz	I <sub>cu</sub>	kA	35
525 V 50/60 Hz	I <sub>cu</sub>	kA	25
690 V 50/60 Hz	I <sub>cu</sub>	kA	20
lcs to IEC/EN 60947 test cycle 0-t-C0-t-C0	lcs	kA	-
240 V 50/60 Hz	I <sub>cs</sub>	kA	37
400/415 V 50/60 Hz	I <sub>cs</sub>	kA	37
440 V 50/60 Hz	I <sub>cs</sub>	kA	26
525 V 50/60 Hz		kA	19
	I <sub>cs</sub>		
690 V 50/60 Hz	I <sub>cs</sub>	kA	Maximum back-up fuse, if the expected short-circuit currents at the installation location exceed the switching capacity of the circuit-breaker.
Rated short-time withstand current			

t = 0.3 s	ı	kA	19.2
	I <sub>cw</sub>		
t = 1 s	I <sub>cw</sub>	kA	19.2
Utilization category to IEC/EN 60947-2			В
Lifespan, mechanical(of which max. 50 % trip by shunt/undervoltage release)	Operations		10000
Lifespan, electrical			
AC-1			
400 V 50/60 Hz	Operations		3000
415 V 50/60 Hz	Operations		3000
690 V 50/60 Hz	Operations		2000
Max. operating frequency		Ops/h	60
Total break time at short-circuit		ms	< 25 ≦ 415 V; < 35 > 415 V
Terminal capacity			
Standard equipment			Screw connection
Optional accessories			Tunnel terminal connection on rear Strip terminal
Round copper conductor			
Tunnel terminal			
Stranded			
4-hole		$mm^2$	4 x (50 - 240)
Bolt terminal and rear-side connection			
Direct on the switch			
Stranded		mm <sup>2</sup>	1 x (120 - 185)
			4 x (50 - 185)
Module plate			
Single hole	min.	mm <sup>2</sup>	1 x (120 - 300)
Single hole	max.	mm <sup>2</sup>	2 x (95 - 300)
Module plate			
Double hole	min.	mm <sup>2</sup>	2 x (95 - 185)
Double hole	max.	mm <sup>2</sup>	4 x (35 - 185)
Connection width extension			
		mm <sup>2</sup>	
Connection width extension		mm <sup>2</sup>	4 x 300 6 x (95 - 240)
Al circular conductor			
Tunnel terminal			
Stranded			
4-hole		mm <sup>2</sup>	4 x (50 - 240)
Cu strip (number of segments x width x segment thickness)			
Flat conductor terminal			
	min.	mm	6 x 16 x 0.8
	max.	mm	(2 x) 10 x 32 x 1.0
Module plate			
Single hole		mm	(2 x) 10 x 50 x 1.0
Bolt terminal and rear-side connection			
Flat copper strip, with holes	min.	mm	5 x 25 x 1.0
Flat copper strip, with holes	max.	mm	(2 x) 10 x 50 x 1.0
Connection width extension		mm	(2 x) 10 x 80 x 1.0
Copper busbar (width x thickness)	mm		
Bolt terminal and rear-side connection			
Screw connection			M10
Direct on the switch			
	min.	mm	25 x 5
	max.	mm	2 x (50 x 10)
Module plate			
Single hole	min.	mm	25 x 5
Single hole	max.	mm	2 x (50 x 10)
	270		100 000

Module plate			
Double hole		mm	2 x (50 x 10)
Connection width extension		mm	
Connection width extension	min.	mm	60 x 10
Connection width extension	max.	mm	2 x (80 x 10)
Control cables			
		mm <sup>2</sup>	1 x (0.75 - 2.5) 2 x (0.75 - 1.5)

**Design verification as per IEC/EN 61439** 

Design vernication as per 126/214 01433			
Technical data for design verification			
Rated operational current for specified heat dissipation	In	Α	1600
Equipment heat dissipation, current-dependent	P <sub>vid</sub>	W	284
Operating ambient temperature min.		°C	-25
Operating ambient temperature max.		°C	70
IEC/EN 61439 design verification			
10.2 Strength of materials and parts			
10.2.2 Corrosion resistance			Meets the product standard's requirements.
10.2.3.1 Verification of thermal stability of enclosures			Meets the product standard's requirements.
10.2.3.2 Verification of resistance of insulating materials to normal heat			Meets the product standard's requirements.
10.2.3.3 Verification of resistance of insulating materials to abnormal heat and fire due to internal electric effects			Meets the product standard's requirements.
10.2.4 Resistance to ultra-violet (UV) radiation			Meets the product standard's requirements.
10.2.5 Lifting			Does not apply, since the entire switchgear needs to be evaluated.
10.2.6 Mechanical impact			Does not apply, since the entire switchgear needs to be evaluated.
10.2.7 Inscriptions			Meets the product standard's requirements.
10.3 Degree of protection of ASSEMBLIES			Does not apply, since the entire switchgear needs to be evaluated.
10.4 Clearances and creepage distances			Meets the product standard's requirements.
10.5 Protection against electric shock			Does not apply, since the entire switchgear needs to be evaluated.
10.6 Incorporation of switching devices and components			Does not apply, since the entire switchgear needs to be evaluated.
10.7 Internal electrical circuits and connections			Is the panel builder's responsibility.
10.8 Connections for external conductors			Is the panel builder's responsibility.
10.9 Insulation properties			
10.9.2 Power-frequency electric strength			Is the panel builder's responsibility.
10.9.3 Impulse withstand voltage			Is the panel builder's responsibility.
10.9.4 Testing of enclosures made of insulating material			Is the panel builder's responsibility.
10.10 Temperature rise			The panel builder is responsible for the temperature rise calculation. Eaton will provide heat dissipation data for the devices.
10.11 Short-circuit rating			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.12 Electromagnetic compatibility			Is the panel builder's responsibility. The specifications for the switchgear must be observed.
10.13 Mechanical function			The device meets the requirements, provided the information in the instruction leaflet (IL) is observed.

#### **Technical data ETIM 8.0**


Low-voltage industrial components (EG000017) / Power circuit-breaker for trafo/generator/installation protection (EC000228)

Electric engineering, automation, process control engineering / Low-voltage switch technology / Circuit breaker (LV < 1 kV) / Circuit breaker for power transformer, generator and system protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])

protection (ecl@ss10.0.1-27-37-04-09 [AJZ716013])		
Rated permanent current lu	Α	1600
Rated voltage	V	690 - 690
Rated short-circuit breaking capacity Icu at 400 V, 50 Hz	kA	37
Overload release current setting	А	640 - 1600
Adjustment range short-term delayed short-circuit release	А	2 - 10
Adjustment range undelayed short-circuit release	А	3200 - 38400
Integrated earth fault protection		Yes
Type of electrical connection of main circuit		Screw connection
Device construction		Built-in device fixed built-in technique

Suitable for DIN rail (top hat rail) mounting	No
DIN rail (top hat rail) mounting optional	No
Number of auxiliary contacts as normally closed contact	0
Number of auxiliary contacts as normally open contact	0
Number of auxiliary contacts as change-over contact	0
With switched-off indicator	No
With integrated under voltage release	No
Number of poles	4
Position of connection for main current circuit	Front side
Type of control element	Rocker lever
Complete device with protection unit	Yes
Motor drive integrated	No
Motor drive optional	Yes
Degree of protection (IP)	IP20

## **Dimensions**

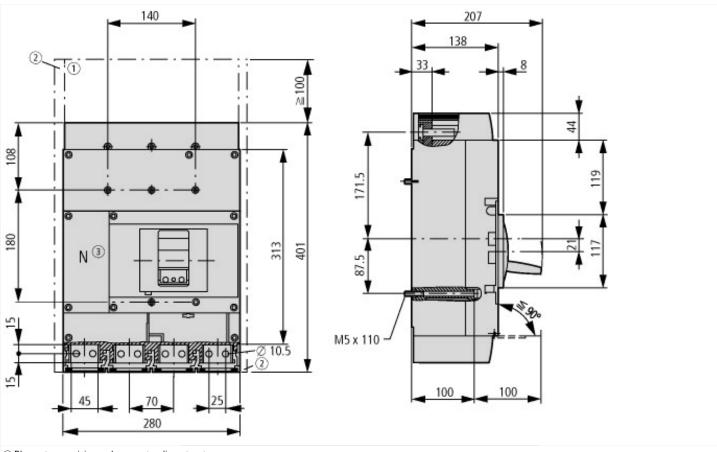

- $\bigodot$  Blow out area, minimum clearance to adjacent parts Ui  $\leq$  690 V: 100 mm Ui  $\leq$  1500 V: 200 mm

- ② Minimum clearance to adjacent parts Ui ≤ 1000 V: 15 mm
- Ui ≤ 1500 V: 70 mm

## **Additional product information (links)**

IL012101ZU NZM4-PXR circuit-breaker, basic d	evice, NZM4-PXR Circuit-Breaker, basic unit
IL012101ZU NZM4-PXR circuit-breaker, basic device, NZM4-PXR Circuit-Breaker, basic unit	https://es-assets.eaton.com/DOCUMENTATION/AWA_INSTRUCTIONS/IL012101ZU2022_01.pdf
Weight	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.171
Temperature dependency, Derating	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.172
Effective power loss	http://ecat.moeller.net/flip-cat/?edition=HPLEN&startpage=17.174
additional technical information for NZM power switch	https://es-assets.eaton.com/DOCUMENTATION/PDF/nzm_technic_de_en.pdf