

Product Environmental Profile

Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC

Representative of all Acti9 iID - RCCB - A, A-SI, AC type - 1P up to 4P - up to 100A - up to 300mA






General information

Reference product	Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC - A9R11463
Description of the product	The Acti9 iID differential switch ensures the protection of people against electric shock by direct and indirect contact as well as the protection of installations against the risk of fire.
Description of the range	The environmental impacts of this reference product are representative of the impacts of the other products of the range which are developed with a similar technology. The products of the range are: In addition of the reference product, this PEP covers all Acti9 iID type A, A-SI and AC with 1P, 1P+N, 2P and 3P+N/4P up to 100A up to 300mA.
Functional unit	Protect people and premises at risk of fire or explosion against insulation defects in a circuit with rated voltage 380/415VAC (Ue), rated current 63A (In), with 4 poles, sensitivity 30mA (S), and the differential protection type AC, and if applicable the specific specifications, in the Industrial application area, while protecting them against the penetration of solid objects and liquids (IP20), according to the appropriate use scenario, and during the 20-year reference service life of the product.



Constituent materials

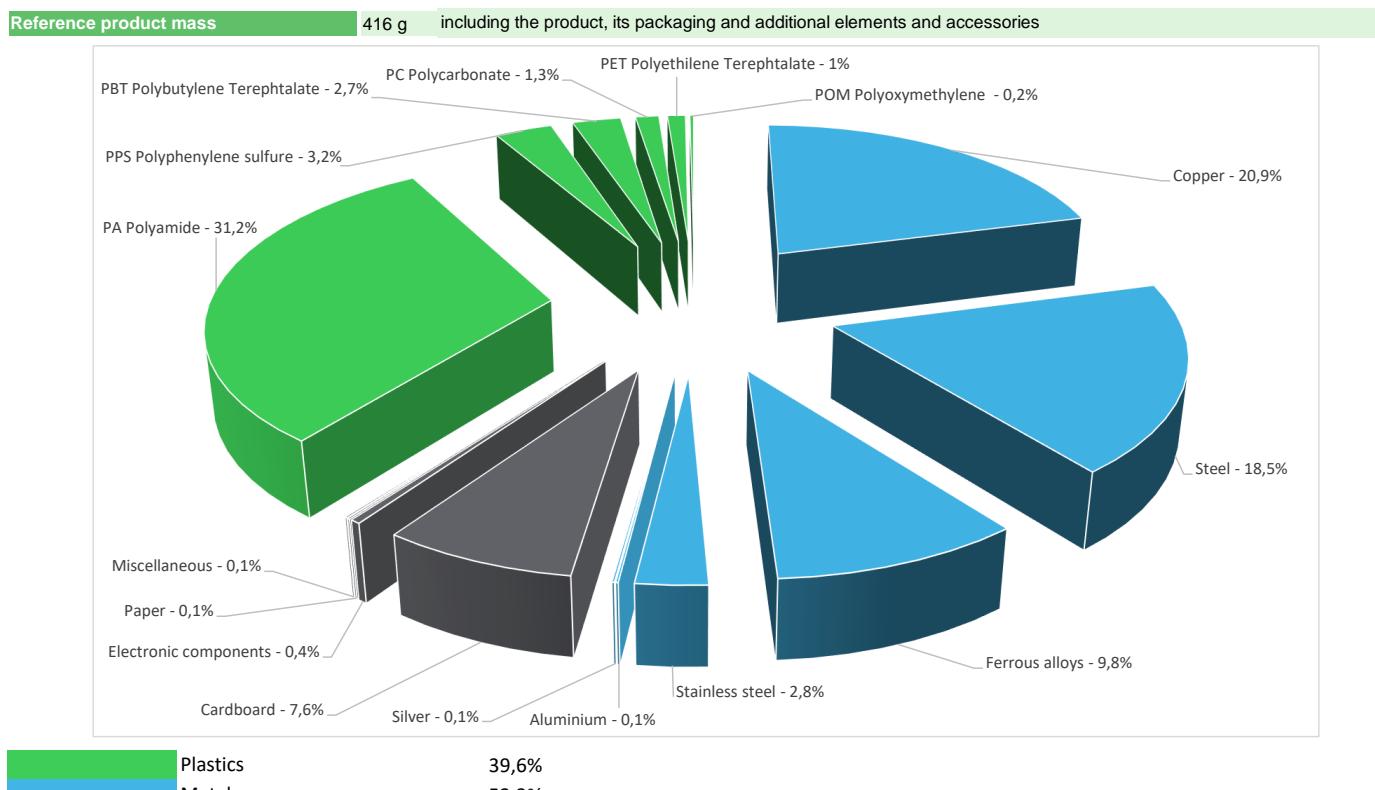

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website
<https://www.se.com/www/en/work/support/green-premium/>



Additional environmental information

End Of Life	Recyclability potential:	53%	The recyclability rate was calculated from the recycling rates of each material making up the product with the exception of data using the ESR database. For materials or components using the ESR database or the absence of data the conservative hypothesis "0% recyclability" was used.
-------------	--------------------------	-----	---



Environmental impacts

Reference service life time	20 years				
Product category	Blocks and differential switches - Industrial				
Installation elements	Ref A9R11463 does not require any installation operations.				
Use scenario	Load rate = 50 % of 63A (In) Use rate = 30% of the 20 years (RLT)				
Time representativeness	The collected data are representative of the year 2023				
Technological representativeness	The Acti9 iID differential switch ensures the protection of people against electric shock by direct and indirect contact as well as the protection of installations against the risk of fire.				
Geographical representativeness	Europe				
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]	
	Spain, ES	Europe, EU-27	Europe, EU-27	Europe, EU-27	

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators		Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC - A9R11463						
Impact indicators	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to climate change	kg CO2 eq	6,08E+01	3,19E+00	8,11E-02	3,60E-02	5,65E+01	9,36E-01	-5,48E-01
Contribution to climate change-fossil	kg CO2 eq	6,06E+01	3,09E+00	8,11E-02	3,43E-02	5,65E+01	9,18E-01	-5,32E-01
Contribution to climate change-biogenic	kg CO2 eq	1,93E-01	9,72E-02	0*	1,70E-03	7,54E-02	1,86E-02	-1,61E-02
Contribution to climate change-land use and land use change	kg CO2 eq	8,08E-06	7,60E-06	0*	0*	0*	4,76E-07	0,00E+00
Contribution to ozone depletion	kg CFC-11 eq	8,74E-07	6,21E-07	1,24E-10	4,65E-10	2,42E-07	1,12E-08	-1,06E-07
Contribution to acidification	mol H+ eq	3,57E-01	3,03E-02	5,13E-04	1,05E-04	3,23E-01	3,87E-03	-1,51E-02
Contribution to eutrophication, freshwater	kg (PO4)3- eq	8,92E-04	1,54E-04	0*	8,23E-07	1,55E-04	5,83E-04	-8,25E-07
Contribution to eutrophication marine	kg N eq	4,03E-02	2,67E-03	2,40E-04	4,57E-05	3,67E-02	6,52E-04	-4,04E-04
Contribution to eutrophication, terrestrial	mol N eq	5,90E-01	2,82E-02	2,64E-03	3,18E-04	5,51E-01	7,86E-03	-4,73E-03
Contribution to photochemical ozone formation - human health	kg COVNM eq	1,31E-01	9,91E-03	6,65E-04	7,29E-05	1,18E-01	2,18E-03	-2,31E-03
Contribution to resource use, minerals and metals	kg Sb eq	1,02E-03	1,00E-03	0*	0*	4,10E-06	1,85E-05	-2,14E-04
Contribution to resource use, fossils	MJ	1,52E+03	5,28E+01	1,13E+00	3,56E-01	1,44E+03	2,99E+01	-1,11E+01
Contribution to water use	m3 eq	3,88E+00	1,18E+00	0*	2,77E-03	2,00E+00	6,96E-01	-7,59E-01
Inventory flows Indicators		Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC - A9R11463						
Inventory flows	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	2,78E+02	1,25E+00	0*	4,67E-02	2,77E+02	4,56E-01	-3,89E-01
Contribution to use of renewable primary energy resources used as raw material	MJ	1,20E+00	1,20E+00	0*	0*	0*	0*	-9,30E-03
Contribution to total use of renewable primary energy resources	MJ	2,80E+02	2,45E+00	0*	4,67E-02	2,77E+02	4,56E-01	-3,99E-01
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	1,52E+03	4,85E+01	1,13E+00	3,56E-01	1,44E+03	2,99E+01	-1,11E+01
Contribution to use of non renewable primary energy resources used as raw material	MJ	4,33E+00	4,33E+00	0*	0*	0*	0*	0,00E+00
Contribution to total use of non-renewable primary energy resources	MJ	1,52E+03	5,28E+01	1,13E+00	3,56E-01	1,44E+03	2,99E+01	-1,11E+01
Contribution to use of secondary material	kg	2,23E-05	2,23E-05	0*	0*	0*	0*	0,00E+00
Contribution to use of renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*	0,00E+00
Contribution to use of non renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*	0,00E+00
Contribution to net use of freshwater	m³	9,04E-02	2,75E-02	0*	6,46E-05	4,66E-02	1,62E-02	-1,77E-02
Contribution to hazardous waste disposed	kg	2,40E+01	2,30E+01	0*	0*	1,06E+00	0*	-1,82E+01
Contribution to non hazardous waste disposed	kg	1,04E+01	2,06E+00	2,84E-03	1,54E-02	8,14E+00	1,60E-01	-3,17E-01
Contribution to radioactive waste disposed	kg	2,75E-03	1,03E-03	2,02E-06	1,90E-06	1,70E-03	9,40E-06	-1,56E-04
Contribution to components for reuse	kg	0,00E+00	0*	0*	0*	0*	0*	0,00E+00
Contribution to materials for recycling	kg	4,47E-01	2,00E-01	0*	0*	0*	2,48E-01	0,00E+00
Contribution to materials for energy recovery	kg	0,00E+00	0*	0*	0*	0*	0*	0,00E+00
Contribution to exported energy	MJ	5,08E-03	1,46E-03	0*	1,47E-03	0*	2,15E-03	0,00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Contribution to biogenic carbon content of the product	kg de C	0,00E+00
Contribution to biogenic carbon content of the associated packaging	kg de C	9,48E+00

Mandatory Indicators		Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC - A9R11463							
Impact indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	5,65E+01	0*	0*	0*	0*	0*	5,65E+01	0*
Contribution to climate change-fossil	kg CO2 eq	5,65E+01	0*	0*	0*	0*	0*	5,65E+01	0*
Contribution to climate change-biogenic	kg CO2 eq	7,54E-02	0*	0*	0*	0*	0*	7,54E-02	0*
Contribution to climate change-land use and land use change	kg CO2 eq	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to ozone depletion	kg CFC-11 eq	2,42E-07	0*	0*	0*	0*	0*	2,42E-07	0*
Contribution to acidification	mol H+ eq	3,23E-01	0*	0*	0*	0*	0*	3,23E-01	0*
Contribution to eutrophication, freshwater	kg (PO4)3- eq	1,55E-04	0*	0*	0*	0*	0*	1,55E-04	0*
Contribution to eutrophication marine	kg N eq	3,67E-02	0*	0*	0*	0*	0*	3,67E-02	0*
Contribution to eutrophication, terrestrial	mol N eq	5,51E-01	0*	0*	0*	0*	0*	5,51E-01	0*
Contribution to photochemical ozone formation - human health	kg COVNM eq	1,18E-01	0*	0*	0*	0*	0*	1,18E-01	0*
Contribution to resource use, minerals and metals	kg Sb eq	4,10E-06	0*	0*	0*	0*	0*	4,10E-06	0*
Contribution to resource use, fossils	MJ	1,44E+03	0*	0*	0*	0*	0*	1,44E+03	0*
Contribution to water use	m3 eq	2,00E+00	0*	0*	0*	0*	0*	2,00E+00	0*

Inventory flows Indicators		Acti9 iID - Residual current circuit breaker (RCCB) - 4P - 63A - 30mA - type AC - A9R11463							
Inventory flows	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	2,77E+02	0*	0*	0*	0*	0*	2,77E+02	0*
Contribution to use of renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of renewable primary energy resources	MJ	2,77E+02	0*	0*	0*	0*	0*	2,77E+02	0*
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	1,44E+03	0*	0*	0*	0*	0*	1,44E+03	0*
Contribution to use of non renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of non-renewable primary energy resources	MJ	1,44E+03	0*	0*	0*	0*	0*	1,44E+03	0*
Contribution to use of secondary material	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of non renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to net use of freshwater	m³	4,66E-02	0*	0*	0*	0*	0*	4,66E-02	0*
Contribution to hazardous waste disposed	kg	1,06E+00	0*	0*	0*	0*	0*	1,06E+00	0*
Contribution to non hazardous waste disposed	kg	8,14E+00	0*	0*	0*	0*	0*	8,14E+00	0*
Contribution to radioactive waste disposed	kg	1,70E-03	0*	0*	0*	0*	0*	1,70E-03	0*
Contribution to components for reuse	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for recycling	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for energy recovery	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to exported energy	MJ	0*	0*	0*	0*	0*	0*	0*	0*

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIMe version v6.1, database version 2023-02 in compliance with ISO14044, EF 3.0 method is applied, for biogenic carbon storage, assessment methodology 0/0 is used

According to this environmental analysis, proportionality rules may be used to evaluate the impacts of other products of this range, ratios to apply can be provided upon request

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

<i>Registration number :</i>	SCHN-00493-V02.01-EN	<i>Drafting rules</i>	PCR-4-ed4-EN-2021 09 06
		<i>Supplemented by</i>	PSR-0005-ed3.1-EN-2023 06 06
<i>Verifier accreditation N°</i>	VH48	<i>Information and reference documents</i>	www.pep-ecopassport.org
<i>Date of issue</i>	03-2024	<i>Validity period</i>	5 years
<i>Independent verification of the declaration and data, in compliance with ISO 14025 : 2006</i>			
Internal	External <input checked="" type="checkbox"/>		
<i>The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)</i>			
<i>PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022</i>			
<i>The components of the present PEP may not be compared with components from any other program.</i>			
<i>Document complies with ISO 14025:2006 "Environmental labels and declarations. Type III environmental declarations"</i>			



Schneider Electric Industries SAS

Country Customer Care Center
<http://www.se.com/contact>

35, rue Joseph Monier
 CS 30323
 F-92500 Rueil Malmaison Cedex
 RCS Nanterre 954 503 439
 Capital social 928 298 512 €

www.se.com

SCHN-00493-V02.01-EN

Published by Schneider Electric

©2024 - Schneider Electric – All rights reserved

03-2024