


INSTALLATION INSTRUCTION

Terminal set OZXB2



Segmental conductors have to be rounded before mounting

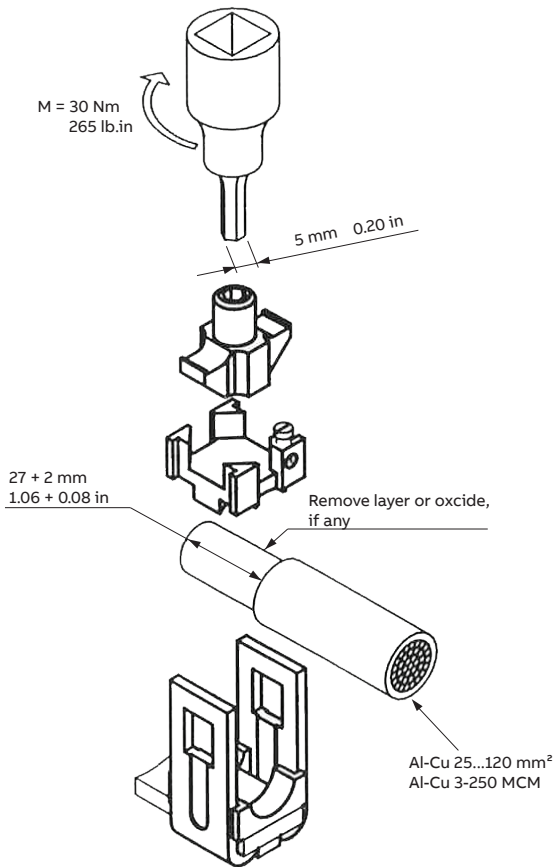

Contact us

ABB Oy

Muottitie 2A 65320

Vaasa, Finland

abb.com/lowvoltage