



INSTA CONTACTOR WITH 2 MAKE CONTACTS  
CONTACT FOR 230,  
400 V AC, 20 A TRIGGERING 230 V AC

Similar to image

| Technical data:                                             |    |       |
|-------------------------------------------------------------|----|-------|
| Mounting depth                                              | mm | 64    |
| Height                                                      | mm | 90    |
| Width                                                       | mm | 18    |
| Depth                                                       | mm | 71    |
| Number of NC contacts                                       |    | 0     |
| Number of NO contacts                                       |    | 2     |
| Number of pitch units for width                             |    | 1     |
| Switching capacity real power / for filament lamp load      | W  | 1,000 |
| Type of voltage                                             |    |       |
| • for operating                                             |    | AC    |
| • of the operating voltage                                  |    | AC    |
| Control supply voltage / rated value                        | V  | 230   |
| Operating current / rated value                             | A  | 20    |
| Operating voltage / rated value                             |    |       |
| • minimum                                                   | V  | 250   |
| • maximum                                                   | V  | 250   |
| Protection class IP                                         |    | IP20  |
| Product extension / can be installed / supplementary device |    | Yes   |

|                                                                                                                                                                     |   |        |
|---------------------------------------------------------------------------------------------------------------------------------------------------------------------|---|--------|
| Product component / slide for manual operation                                                                                                                      |   | No     |
| Control supply voltage / rated value / maximum                                                                                                                      | V | 230    |
| Item designation                                                                                                                                                    |   |        |
| <ul style="list-style-type: none"> <li>• according to DIN EN 61346-2</li> <li>• according to DIN 40719 extendable after IEC 204-2 / according to IEC 750</li> </ul> |   | Q<br>Q |

#### Certificates/approvals:

| General Product Approval                                                                                | Declaration of Conformity                                                         | other                                       |
|---------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------|---------------------------------------------|
|  <a href="#">other</a> |  | <a href="#">Environmental Confirmations</a> |

#### Further information:

##### Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/lowvoltage/catalogs>

##### Industry Mall (Online ordering system)

<http://www.siemens.com/lowvoltage/mall>

##### Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/5TT5800-0/all>

##### Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)


[http://www.automation.siemens.com/bilddb/cax\\_en.aspx?mlfb=5TT5800-0](http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=5TT5800-0)

##### CAX-Online-Generator

<http://www.siemens.com/cax>

##### Tender specifications

[Datanorm GAEB81](#) [GAEB83](#) [RTF](#) [TXT](#)

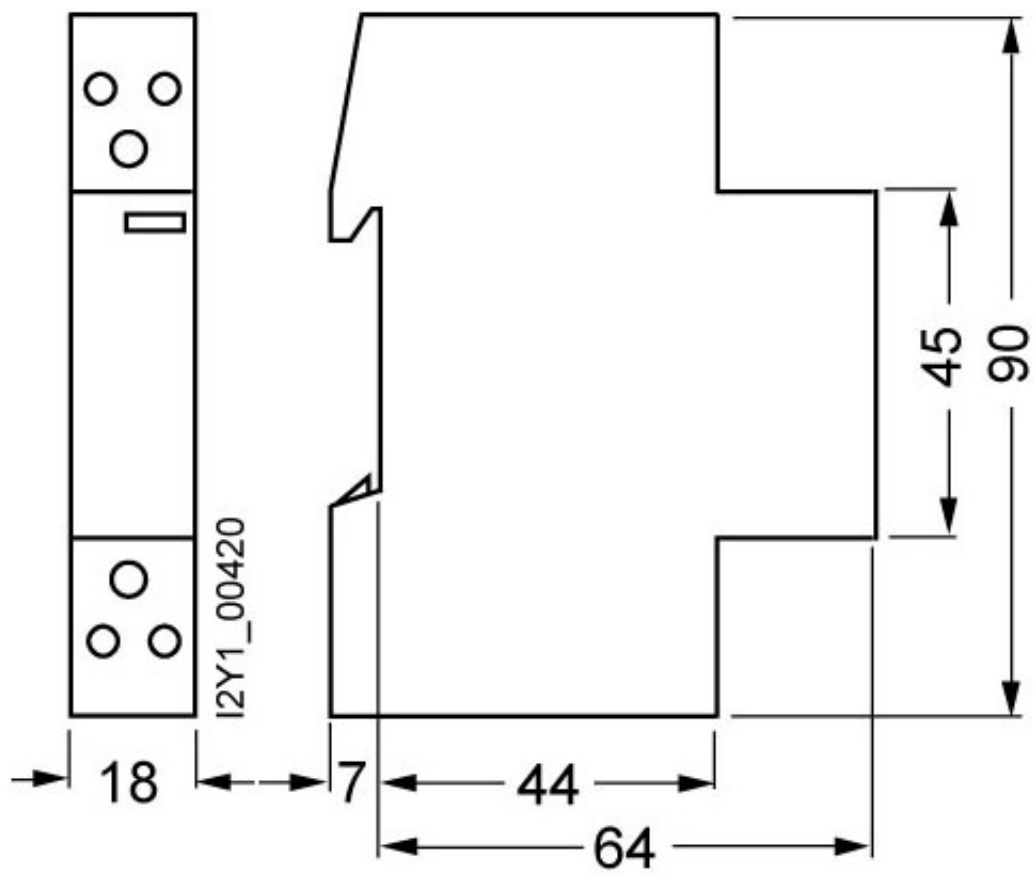

last change:

Mar 18, 2013