SIEMENS

Data sheet 3RR2243-3FA30



MONITORING RELAY ATTACHABLE TO CONTACTOR 3RT2. SIZE S2 STANDARD, DIGITAL ADJUSTABLE APPARENT/ACTIVE CURRENT MONIT. 8 - 80A, 20-400 HZ, 3-PHASE SUPPLY 24 V AC/DC 1 CO CONTACT, 1 SEMICOND. FOR ALARM AND WARNING MONITORING FOR CURRENT OVERSHOOT/UNDERSHOOT PHASE FAILURE, WIRE BREAK PHASE SEQUENCE FAULT CURRENT BLOCKING CURRENT WARNING AND ALARM THRESHOLDS WITH OR W/O ERROR LOG ONDELAY 0-99 S SPURIOUS PEAK SUPPR.0-30 S BREAK AFTER FAULT 0-300 MIN SPRING-LOADED CONNECTION

Figure similar

| General technical data: | | |
|--|----|--|
| product brandname | | SIRIUS |
| • | | |
| Product designation | | Monitoring relays |
| Design of the product | | digitally adjustable, 3-phase current monitoring |
| Size of contactor can be combined company-specific | | S2 |
| Protection class IP | | |
| • on the front | | IP20 |
| of the terminal | | IP00 |
| Insulation voltage for overvoltage category III | V | 690 |
| according to IEC 60664 with degree of pollution 3 | | |
| rated value | | |
| Installation altitude at height above sea level | m | 2 000 |
| maximum | | |
| Ambient temperature | | |
| during storage | °C | -40 +80 |
| during operation | °C | -25 +60 |
| Electromagnetic compatibility | | IEC 60947-1 / IEC 61000-6-2 / IEC 61000-6-4 |
| EMI immunity acc. to IEC 60947-1 | | ambience A (industrial sector) |

| EMC emitted interference acc. to IEC 60947-1 | | ambience A (industrial sector) |
|---|-----|--------------------------------|
| Shock resistance | | 10g / 11 ms |
| Vibration resistance | _ | 10 55 Hz / 0.35 mm |
| Surge voltage resistance rated value | kV | 6 |
| Operating apparent output rated value | V·A | 4 |
| Operating power rated value | W | 2.5 |
| Equipment marking acc. to DIN 40719 extended according to IEC 204-2 acc. to IEC 750 | | К |
| Equipment marking acc. to DIN EN 61346-2 | | К |
| Mechanical service life (switching cycles) typical | | 10 000 000 |
| Electrical endurance (switching cycles) at AC-15 at 230 V typical | | 100 000 |
| Accuracy of digital display | | +/-1 digit |
| Adjustable response delay time | | |
| when starting | S | 0 99 |
| with lower or upper limit violation | S | 0 30 |
| Stand-by time for restart after fault | S | 0.2 |
| Phase number | | 3 |
| Number of monitored phases | | 3 |
| Product function | | |
| Overcurrent monitoring | | Yes |
| Undercurrent monitoring | | Yes |
| Overcurrent and undercurrent monitoring | | Yes |
| Apparent current monitoring | | Yes |
| active current monitoring | | Yes |
| undercurrent detection DC | | No |
| undercurrent detection 1 phase | | No |
| Overcurrent detection DC | | No |
| Current window recognition DC | | No |
| undercurrent detection 3 phases | | Yes |
| Overcurrent detection 1 phase | | No |
| Voltage window recognition 3 phase | | No |
| Voltage window recognition 1 phase | | No |
| • phase sequence recognition | | Yes |
| can be activated or deactivated phase sequence recognition | | Yes |
| Auto-reset | | Yes |
| External reset | | No |
| Manual RESET | | Yes |
| Adjustable pick-up value current | | |
| • 1 | Α | 8 80 |
| • 2 | Α | 8 80 |

| | 2 5 |
|------|-----------------|
| | |
| Α | 8 |
| | |
| | |
| % | 5 |
| | AC |
| Α | 8 80 |
| Α | 0.2 16 |
| | |
| ms | 200 |
| % | 2 |
| %/°C | 0.1 |
| | |
| Α | 80 |
| | |
| Α | 1 600 |
| | |
| | % A A ms % %/°C |

| Supply voltage: | | |
|--|----|-------|
| Type of voltage of the supply voltage | | AC/DC |
| Supply voltage frequency 1 | Hz | 50 60 |
| Supply voltage 1 | | |
| at DC rated value | V | 24 |
| • at AC | | |
| — at 50 Hz rated value | V | 24 |
| — at 60 Hz rated value | V | 24 |
| Buffering time in the event of power failure minimum | ms | 10 |

| Auxiliary circuit: | | |
|--|----|---|
| Circuit principle of the output relay | | closed-circuit current / open-circuit current |
| Operating current at 17 V minimum | mA | 5 |
| Number of outputs as contact-less semiconductor switching element for signaling function instantaneous contact | | 1 |
| Ampacity of the semiconductor output | | |
| ● at DC-13 at 240 V | mA | 20 |
| ● at AC-14 at 240 V at 50/60 Hz | mA | 20 |
| Residual current of the semiconductor output maximum | mA | 0.035 |
| Number of CO contacts | | |
| for auxiliary contacts | | 1 |
| Operating current of auxiliary contacts | | |
| ● at AC-15 | | |
| — at 24 V | Α | 3 |

| — at 230 V | Α | 3 |
|------------|---|-----|
| — at 400 V | Α | 3 |
| • at DC-13 | | |
| — at 24 V | Α | 1 |
| — at 125 V | Α | 0.2 |
| — at 250 V | Α | 0.1 |

Inputs/ Outputs:

Short-circuit:

| Mounting type direct mounting Width mm 55 Height mm 99 Depth mm 112 Required spacing with side-by-side mounting """""""""""""""""""""""""""""""""""" | Installation/ mounting/ dimensions: | | |
|---|---|----|-----------------|
| Width mm 55 Height mm 99 Depth mm 112 Required spacing with side-by-side mounting mm 0 • forwards mm 0 • Backwards mm 0 • downwards mm 10 • at the side mm 0 Required spacing for grounded parts • forwards mm 10 • Backwards mm 10 • downwards mm 10 • at the side mm 10 Required spacing for live parts • forwards mm 10 • Backwards mm 0 • porwards mm 10 • downwards mm 0 • upwards mm 0 • downwards mm 10 • downwards m | Mounting position | | any |
| Height mm 99 Depth mm 112 Required spacing with side-by-side mounting • forwards • Backwards • upwards • at the side Required spacing for grounded parts • forwards • upwards • mm 10 Required spacing for grounded parts • forwards • at the side Required spacing for grounded parts • forwards • Backwards • mm 10 • at the side Required spacing for live parts • forwards • at the side Required spacing for live parts • forwards • at the side Required spacing for live parts • forwards • at the side Required spacing for live parts • forwards • at the side Required spacing for live parts • forwards • forwards • forwards • forwards • mm 10 • downwards • mm 10 • downwards • mm 10 • downwards • mm 10 | Mounting type | | direct mounting |
| Depth mm 112 Required spacing with side-by-side mounting • forwards mm 0 • Backwards mm 0 • upwards mm 10 • at the side mm 0 Required spacing for grounded parts • forwards mm 10 • Backwards mm 10 • Backwards mm 10 • Backwards mm 10 • Backwards mm 10 • upwards mm 10 • upwards mm 10 • downwards mm 10 • downwards mm 10 • downwards mm 10 • at the side mm 10 Required spacing for live parts • forwards • at the side mm 10 Required spacing for live parts • forwards • backwards • mm 10 Required spacing for live parts • forwards • downwards • downwards • mm 10 Required spacing for live parts • forwards • downwards • mm 10 • downwards • mm 10 • downwards • downwards • mm 10 • downwards • mm 10 | Width | mm | 55 |
| Required spacing with side-by-side mounting • forwards • Backwards • upwards • downwards • at the side Required spacing for grounded parts • forwards • Backwards • mm 10 Required spacing for grounded parts • forwards • at the side mm 0 Required spacing for grounded parts • forwards • aupwards • mm 10 • downwards • at the side mm 10 Required spacing for live parts • forwards • forwards • at the side mm 10 Required spacing for live parts • forwards • backwards • mm 10 Required spacing for live parts • forwards • forwards • downwards • downwards • mm 10 Required spacing for live parts • forwards • forwards • forwards • downwards • mm 10 downwards • downwards mm 10 downwards | Height | mm | 99 |
| forwards Backwards upwards downwards at the side forwards forwards mm Backwards upwards mm Backwards upwards upwards at the side mm 10 downwards upwards at the side mm 10 Required spacing for live parts forwards at the side mm 10 Required spacing for live parts forwards mm 0 Backwards mm 10 downwards mm 10 downwards mm 10 downwards mm 10 | | mm | 112 |
| Backwards upwards downwards at the side mm at the side mm forwards forwards Backwards upwards upwards at the side mm downwards at the side mm at the side mm backwards mm mm mm to at the side mm to eart the side mm mm to Backwards mm mm to Backwards mm mm to upwards upwards mm downwards mm to upwards mm to upwards mm to downwards mm to downwards mm to downwards mm to downwards mm to to<th>Required spacing with side-by-side mounting</th><th></th><th></th> | Required spacing with side-by-side mounting | | |
| upwards downwards at the side mm 0 Required spacing for grounded parts forwards Backwards upwards downwards at the side mm at the side mm forwards mm fownwards mm at the side mm forwards forwards forwards forwards mm forwards mm fowards mm fowards mm downwards mm fowards mm downwards mm fowards mm fowards mm mm fowards mm mm fowards mm fowards<th>• forwards</th><th>mm</th><th>0</th> | • forwards | mm | 0 |
| downwards at the side mm 0 Required spacing for grounded parts forwards Backwards upwards downwards at the side mm 4 the side mm mm mm mm mm mm mm to at the side mm mm mm to Backwards mm Backwards upwards upwards upwards mm downwards mm mm mm to upwards downwards mm mm mm to downwards mm mm mm mm to | Backwards | mm | 0 |
| at the side Required spacing for grounded parts forwards Backwards upwards downwards at the side forwards forwards at the side mm forwards forwards forwards forwards forwards mm Backwards upwards upwards upwards downwards mm 10 | • upwards | mm | 0 |
| Required spacing for grounded parts • forwards • Backwards • upwards • downwards • at the side Required spacing for live parts • forwards • forwards • mm 10 Required spacing for live parts • forwards • upwards • upwards • upwards • downwards mm 10 | • downwards | mm | 10 |
| forwards Backwards upwards upwards downwards at the side mm 10 Required spacing for live parts forwards Backwards upwards upwards downwards mm 10 Backwards upwards downwards mm 10 | • at the side | mm | 0 |
| Backwards upwards downwards at the side at the side forwards Backwards upwards upwards downwards mm 10 Backwards upwards downwards mm 10 mm 10 | Required spacing for grounded parts | | |
| upwards downwards at the side mm 10 at the side mm 10 Required spacing for live parts forwards Backwards upwards upwards downwards mm 10 downwards mm 10 10 mm < | • forwards | mm | 10 |
| downwards at the side mm 10 Required spacing for live parts forwards Backwards upwards downwards mm 10 mm 10 mm 10 mm 10 downwards mm 10 | Backwards | mm | 0 |
| at the side mm Required spacing for live parts forwards Backwards upwards downwards mm 10 mm 10 mm 10 mm 10 | • upwards | mm | 10 |
| Required spacing for live parts • forwards • Backwards • upwards • downwards mm 10 mm 10 mm 10 | • downwards | mm | 10 |
| forwards Backwards upwards downwards mm 10 mm 10 mm 10 | • at the side | mm | 10 |
| Backwards upwards downwards mm 10 mm 10 | Required spacing for live parts | | |
| upwards downwards mm 10 10 | • forwards | mm | 10 |
| • downwards mm 10 | Backwards | mm | 0 |
| | • upwards | mm | 10 |
| • at the side mm 10 | • downwards | mm | 10 |
| | • at the side | mm | 10 |

Connections/ Terminals:

| Type of electrical connection | |
|--|-------------------------|
| for main current circuit | screw-type terminals |
| for auxiliary and control current circuit | spring-loaded terminals |
| Product function | |
| removable terminal for main circuit | No |
| removable terminal for auxiliary and control circuit | Yes |

| Type of connectable conductor cross-sections | | |
|---|-----|----------------------------------|
| • for main contacts | | |
| — solid | | 2x (1 35 mm²), 1x (1 50 mm²) |
| — stranded | | 2x (1 35 mm²), 1x (1 50 mm²) |
| — finely stranded | | |
| — with core end processing | | 2x (1 25 mm²), 1x (1 35 mm²) |
| at AWG conductors | | |
| — for main contacts | | 2x (18 2), 1x (18 1) |
| — for auxiliary contacts | | 2x (24 16) |
| for auxiliary contacts | | |
| — solid | | 1x (0.5 4 mm²), 2x (0.5 2.5 mm²) |
| — finely stranded | | |
| — with core end processing | | 2x (0.25 1.5 mm²) |
| without core end processing | | 2x (0.25 1.5 mm²) |
| Tightening torque with screw-type terminals | N·m | 0.8 1.2 |

| Certificates/ | annrovale: |
|---------------|------------|
| Certificates/ | appiovais. |

Certificate of suitability CE / UL / CSA

General Product Approval

Declaration of Conformity

Test Certificates











Type Test
Certificates/Test
Report

Shipping Approval





LRS



other

Environmental Confirmations

Confirmation

UL/CSA ratings:

Contact rating of auxiliary contacts according to UL B300 / R300

Safety related data

Protection against electrical shock finger-safe when touched vertically from front acc. to IEC 60529

Further information

Information- and Downloadcenter (Catalogs, Brochures,...)


http://www.siemens.com/industrial-controls/catalogs


Industry Mall (Online ordering system)


http://www.siemens.com/industrymall

Cax online generator

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, EPLAN macros, ...) http://www.automation.siemens.com/bilddb/cax_de.aspx?mlfb=3RR2243-3FA30&lang=en

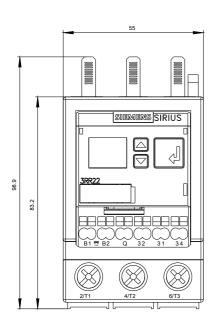

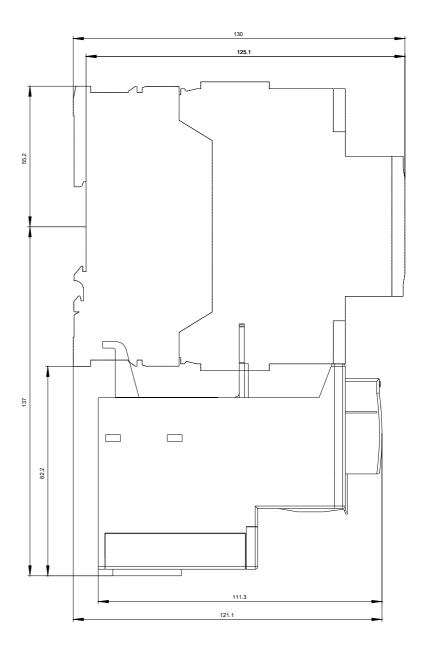

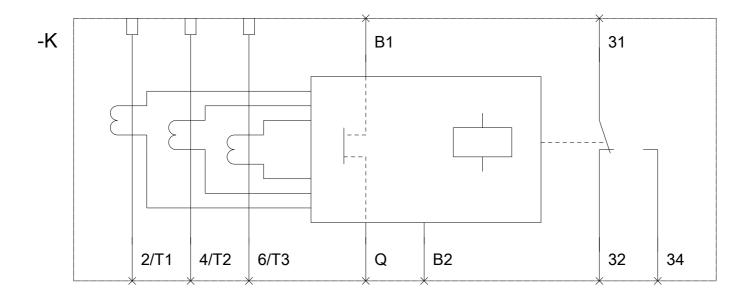

last modified: 07/01/2017